



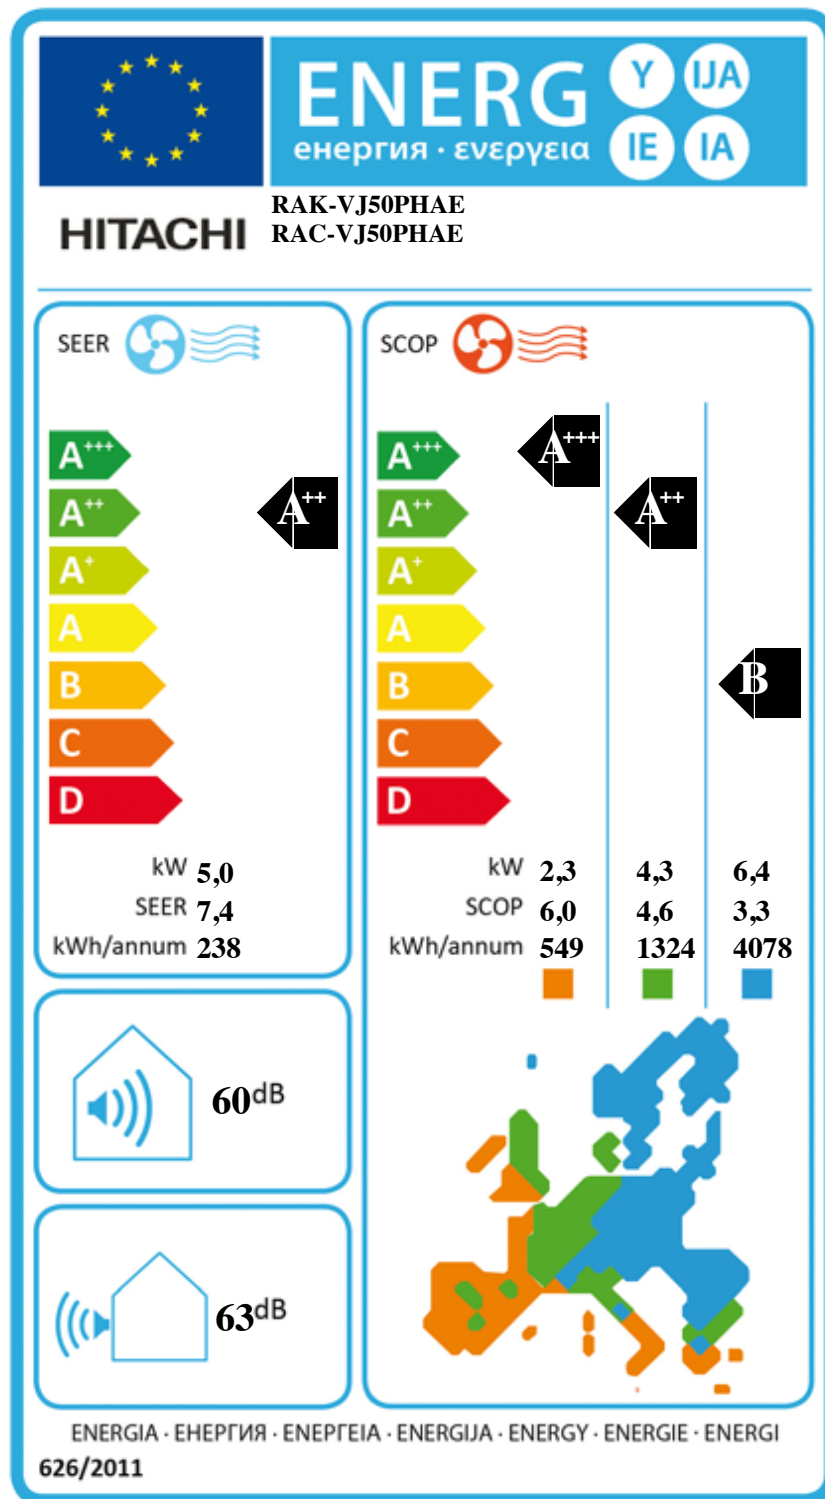

This label is edited by Hitachi's "ErP Active Tool". Ecodesign implementation, in accordance with Annex III of Regulation (EU) No 626/2011 of 4 May 2011, supplementing Directive 2010/30/Eu labeling of equipment air conditioning equipment.

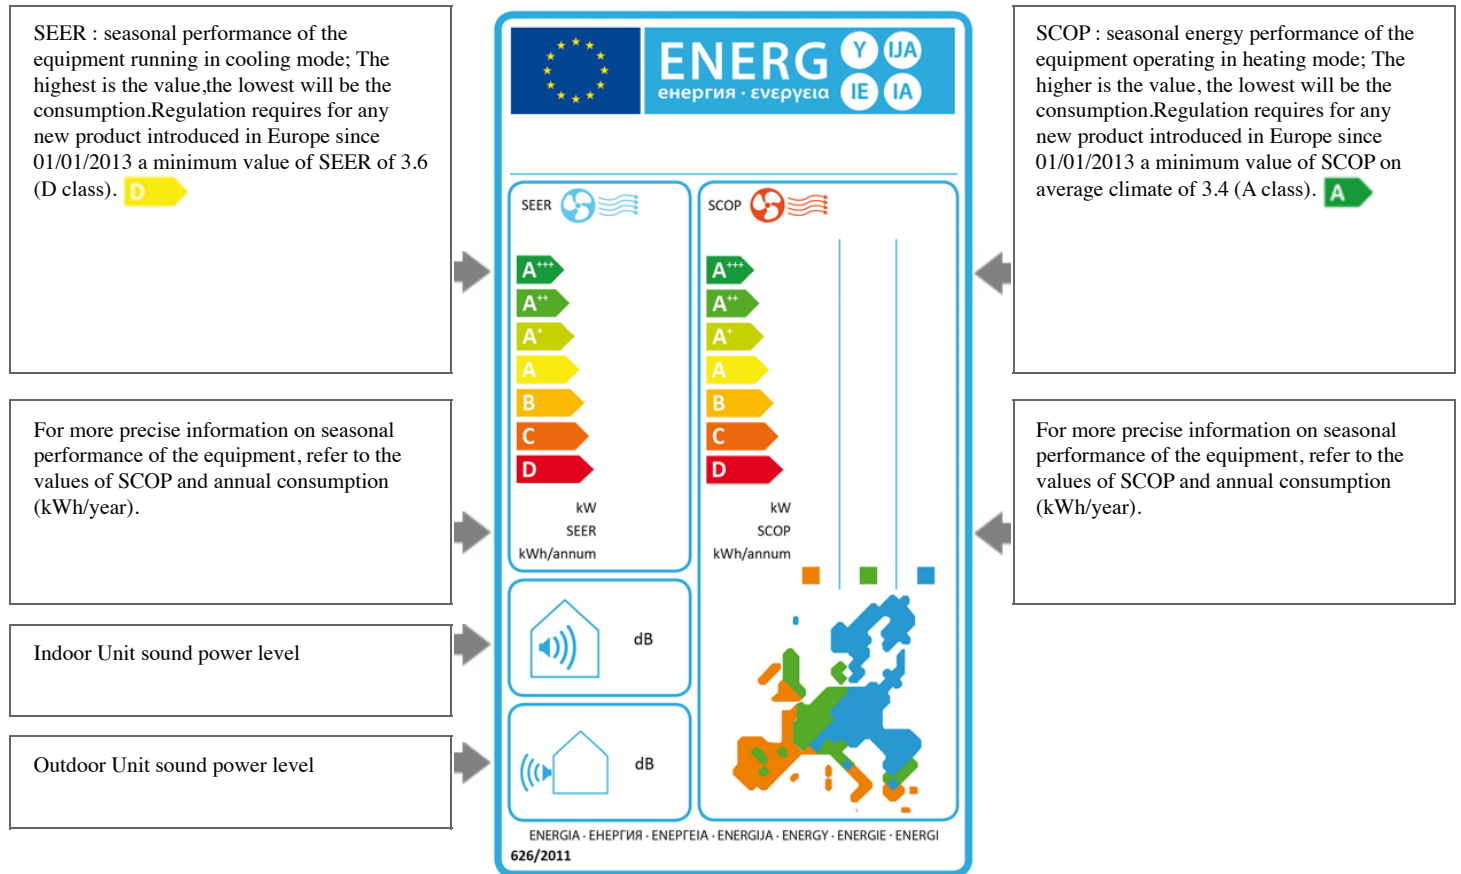

Climates defined by regulation	Lowest outdoor temperature	City used as reference	Heating period (hours/days)
Warm	+2° C	Athene	3590 h / 149 d
Average	-10° C	Strasbourg	4910 h / 204 d
Cold	-22° C	Helsinki	6646 h / 277 d

For heating operation, displayed informations related to the energy consumption are compulsory for average climate. Other climates are optional.